

The Building Regulations 1991

Glazing - safety in relation to impact, opening and cleaning

N

APPROVED DOCUMENT

- N1 Protection against impact**
- N2 Manifestation of glazing**
- N3 Safe opening and closing of windows, skylights and ventilators**
- N4 Safe access for cleaning windows etc**

1998 EDITION

MAIN CHANGES IN THE 1998 EDITION

This edition of Approved Document N, Glazing –safety in relation to impact, opening and cleaning, replaces the 1992 edition. The main changes are:

Requirement N3

Safe opening and closing of windows etc: new requirement to reduce the risk of injury when adjusting windows, skylights and ventilators.

Requirement N4

Safe access for cleaning windows etc: new requirement to reduce risk of injury when cleaning glazed surfaces.

Contents

CONTENTS

Use of Guidance	2
Protection Against Impact And Manifestation Of Glazing The Requirements N1 And N2	4
GUIDANCE	5
Performance	5
Section 1 Protection Against Impact	6
Critical Locations	6
Reducing the risks	6
Safe breakage	6
Robustness	6
Glazing in small panes	7
Permanent screen protection	7
Section 2 Manifestation Of Glazing	8
Critical locations	8
Permanent manifestation of glazing	8
Alternative indications of glazing	8
Safe Opening And Closing Of Windows Etc The Requirement N3	9
GUIDANCE	9
Performance	9
Section 3 Safe Opening And Closing Of Windows Etc	10
Introduction to provisions	10
Location of controls	10
Prevention of falls	10
Safe Access For Cleaning Windows Etc The Requirement N4	11
GUIDANCE	11
Performance	11
Section 4 Safe Access For Cleaning Windows Etc	12
Introduction to-provisions	12
Standards Referred To	14

DIAGRAMS

1 Critical locations in internal and external walls (see para 1.1)	6
2 Annealed glass thickness/ dimension limits (see para 1.4)	6
3 Dimensions and areas of small panes	7
4 Permanent screen protection	7
5 Height of 'manifestation' of large areas of transparent glazing	8
6 Examples Of Door Height Glazing Not Warranting Manifestation	8
7 Height of controls	10
8 Safe reaches for cleaning (see para 4.2)	12
9 Ladders not more than 6m long	13
10 Ladders not more than 9m long	13

Use of Guidance

Use of Guidance

THE APPROVED DOCUMENTS

This document is one of a series that has been approved by the Secretary of State as practical guidance on meeting the requirements of Schedule 1 and regulation 7 of the Buildings Regulations 1991 (SI 1991 No 2768) as amended by the Building Regulations (Amendment) Regulations 1992 (SI 1992 No 1180), the Building Regulations (Amendment) Regulations 1994 (SI 1994 No 1850), the Building Regulations (Amendment) Regulations 1995 (SI 1995 No 1356), and the Building Regulations (Amendment) Regulations 1997 (SI 1997 No. 1904).

At the back of this document is a list of those documents currently published by the Department of the Environment and the Welsh Office which have been approved for the purpose of the Building Regulations 1991.

The Approved Documents are intended to provide guidance for some of the more common building situations. However, there may well be alternative ways of achieving compliance with the requirements. Thus there is no obligation to adopt any particular solution contained in an Approved Document if you prefer to meet the relevant requirement in some other way.

OTHER REQUIREMENTS

The guidance contained in an Approved Document relates only to the particular requirements of the Regulations which that document addresses. The building work will also have to comply with the requirements of any other relevant paragraphs in Schedule 1 of the Regulations. There are Approved Documents which give guidance on each of the other requirements in Schedule 1 and on regulation 7.

LIMITATION ON REQUIREMENTS

In accordance with regulation 8, the requirements in Parts A to K and N of Schedule 1 to the Building Regulations do not require anything to be done except for the purpose of securing reasonable standards of health and safety for persons in or about the building.

MATERIALS AND WORKMANSHIP

Any building work which is subject to the requirements imposed by Schedule 1 of the Building Regulations should, in accordance with regulation 7, be carried out with proper materials and in a workmanlike manner.

You may show that you have complied with regulation 7 in a number of ways. These include the appropriate use of a product bearing CE marking in accordance with the Construction Products Directive (89/106/EEC)¹ as amended by the CE marking Directive (93/68/EEC)², or a product complying with an appropriate technical specification (as defined in those Directives), a British Standard, or an alternative national technical specification of any state which is a contracting party to the European Economic Area which, in use, is equivalent, or a product governed by an agreement certificate such as one issued by the British Board of Agreement. You will find further guidance in the Approved Document supporting regulation 7 on materials and workmanship.

Technical specifications

Building regulations are made for specific purposes: health and safety, energy conservation and the welfare and convenience of disabled people. Standards and technical approvals are relevant guidance to the extent that they relate to these considerations. However, they may also address other aspects of performance such as serviceability, or aspects which although they relate to health and safety are not covered by the Regulations.

When an Approved Document makes reference to a named standard, the relevant version of the standard is the one listed at the end of the publication. However, if this version of the standard has been revised or updated by the issuing standards body, the new version may be used as a source of guidance provided it continues to address the relevant requirements of the Regulations.

The Secretary of State has agreed with the British Board of Agreement on the aspects of performance which it needs to assess in preparing its Certificates in order that the Board may demonstrate the compliance of a product or system which has an Agreement Certificate with the requirements of the Regulations. An Agreement Certificate issued by the Board under these arrangements will give assurance that the product or system to which the Certificate relates, if properly used in accordance with the terms of the Certificate, will meet the relevant requirements.

Similarly, the appropriate use of a product which complies with a European Technical Approval as defined in the Construction Products Directive will also meet the relevant requirements.

¹ As implemented by the Construction Products Regulations 1991 (SI 1991 No 1620)

² As implemented by the Construction Products (Amendment) Regulations 1994 (SI 1994 No 3051)

Mixed use development

In mixed use developments part of a building may be used as a dwelling while another part has a non-domestic use. In such cases, if the requirements of this Part of the Regulations for dwellings and non-domestic use differ, the requirements for non-domestic use should apply in any shared parts of the building.

The Workplace (Health, Safety and Welfare) Regulations 1992

The Workplace (Health, Safety and Welfare) Regulations 1992 contain some requirements which affect building design. The main requirements are now covered by the Building Regulations, but for further information see: Workplace health, safety and welfare, The Workplace (Health, Safety and Welfare) Regulations 1992, Approved Code of Practice and Guidance; The Health and Safety Commission, L24; Published by HMSO 1992; ISBN 0-11-886333-9

The Workplace (Health, Safety and Welfare) Regulations 1992 apply to the common parts of flats and similar buildings if people such as cleaners, wardens and caretakers are employed to work in these common parts. Where the requirements of the Building Regulations that are covered by this Part do not apply to dwellings, the provisions may still be required in the situations described above in order to satisfy the Workplace Regulations.

The Requirements N1 and N2

This Approved Document, which takes effect on 1 January 1998, deals with the following requirement from part N of Schedule 1 to the Building Regulations 1991 as amended by the Building Regulations (Amendment) Regulations 1997.

Requirement	Limits on application
<p>Protection against impact</p> <p>N1. Glazing, with which people are likely to come into contact whilst moving in or about the building, shall –</p> <p>(a) if broken on impact, break in a way which is unlikely to cause injury or</p> <p>(b) resist impact without breaking; or</p> <p>(c) be shielded or protected from impact</p> <p>Manifestation of glazing</p> <p>N2. Transparent glazing, with which people are likely to come into contact while moving in or about the building, shall incorporate features which make it apparent.</p>	<p>Requirement N2 does not apply to dwellings.</p>

Note: Attention is drawn to the following:
Regulation 3 defines building work. Glazing which is installed in a location where there was none previously as part of the erection, extension or material alteration of a building, other than an exempt building, is building work and is subject to the Requirements of Part N. The installation of replacement windows or glazing (e.g. by way of repair), is not building work but its supply may be subject to consumer protection legislation.

Guidance

GUIDANCE

Performance

Requirement N1

0.1 In the Secretary of State's view, requirement N1 will be met by adopting, in critical locations, measures to limit the risk of sustaining cutting and piercing injuries.

0.2 The most likely locations for impacts leading to such injuries are in doors and door side panels and at low level in walls and partitions. In doors and door side panels, the risk is at its greatest between floor and shoulder level, when near to door handles and push plates: especially when normal building movement causes doors to stick. Hands, wrists and arms are particularly vulnerable. An initial impact between waist and shoulder level may be followed by a fall through the glazing, resulting in additional injury to the face and body.

0.3 In walls and partitions, away from doors, the risks are predominantly at low level. At that level, children are especially vulnerable.

0.4 Glazing in critical locations would be considered reasonably safe were its nature such that, if breakage did occur, any particles would be relatively harmless.

0.5 The requirement may also be met if the glazing is sufficiently robust to ensure that the risk of breakage is low, or if steps are taken to limit the risk of contact with the glazing.

Requirement N2

0.6 In the Secretary of State's view, requirement N2 will be met by including in critical locations, permanent means of indicating the presence of large uninterrupted areas of transparent glazing.

0.7 The existence of large uninterrupted areas of transparent glazing represents a significant risk of injury through collision. The risk is at its most severe between areas of a building or its surroundings which are essentially at the same level and where a person might reasonably assume direct access between locations which are separated by glazing.

0.8 In such locations, some means should be adopted to make glazing more apparent or visible to people using the building.

Section 1

Section 1 Protection Against Impact

Critical Locations

1.1 The following locations may be considered 'critical' in terms of safety;

- a. between finished floor level and 800mm above that level in internal and external walls and partitions (see Diagram 1).
- b. between finished floor level and 1 500mm above that level in a door or in a side panel, close to either edge of the door (see Diagram 1).

Reducing the risks

- 1.2 Glazing in critical locations should either,
- a. break safely, if it breaks (see paragraph 1.3), or
 - b. be robust or in small panes (see paragraphs 1.4, 1.5 and 1.6 and Diagrams 2 and 3), or
 - c. be permanently protected (see paragraphs 1.7 and 1.8 and Diagram 4).

Safe breakage

1.3 Safe breakage is defined in BS 6206: 1981 Specification for impact performance requirements for flat safety glass and safety plastics for use in buildings: clause 5.3, and is based on an impact test which requires the result of the impact to be limited to creating:

- a. a small clear opening only, with a limit to the size of the detached particles, or
- b. disintegration, with small detached particles, or
- c. breakage resulting in separate pieces that are not sharp or pointed.

In terms of safe breakage, a glazing material suitable for installation in a critical location would satisfy the requirements of Class C of BS 6206 or, if it is installed in a door or in a door side panel and has a pane width exceeding 900mm, the requirements of Class B of the same standard.

Robustness

1.4 Some glazing materials, such as annealed glass, gain strength through thickness; others such as polycarbonates or glass blocks are inherently strong. Some annealed glass is considered suitable for use in large areas forming fronts to shops, showrooms, offices, factories, and public buildings. Reasonable glass thickness/dimension limits for annealed glass which may be used in these locations are shown in Diagram 2 (see also paragraph 2.1).

DIAGRAM 2 Annealed glass thickness/ dimension limits (see para 1.4)


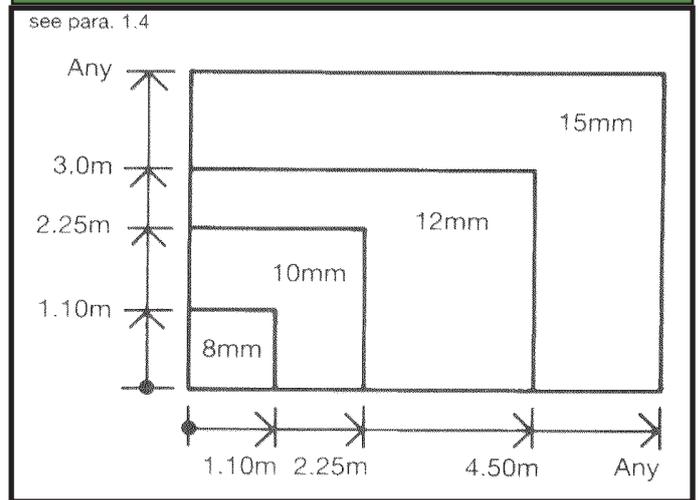



DIAGRAM 1 Critical locations in internal and external walls (see para 1.1)

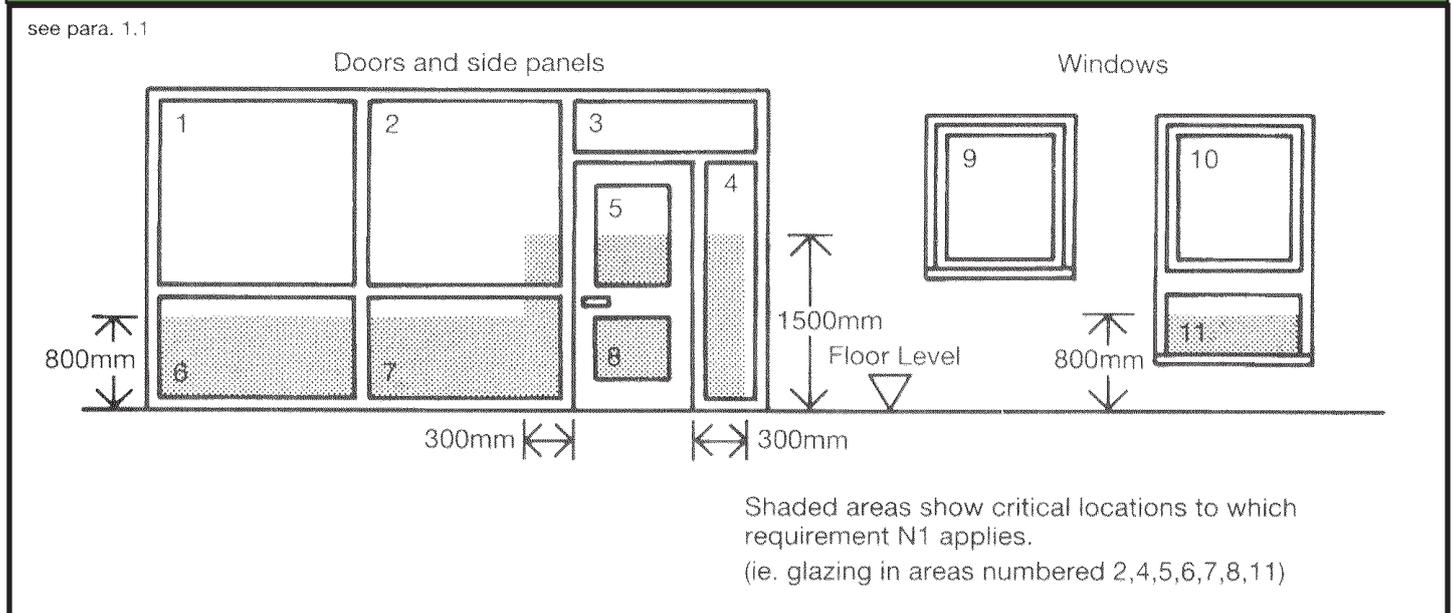

Glazing in small panes

1.5 In the context of this Approved Document, a ‘small pane’ may be an isolated pane, or one of a number of panes contained within glazing bars, traditional leaded lights or copper-lights.

1.6 Small panes should have a smaller dimension not exceeding 250mm and an area not exceeding 0.5m² each measured between glazing beads or similar fixings. Annealed glass in a small pane should not be less than 6 mm nominal thick, except in traditional leaded or copper-lights in which acceptable, when fire resistance was not a factor. Typical installations are shown in Diagram 3.

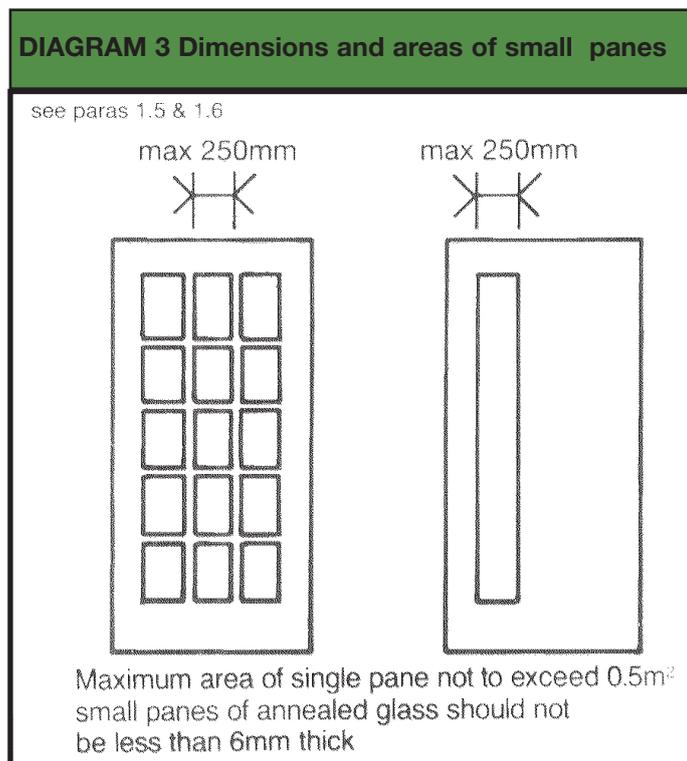


Permanent screen protection

1.7 If, as part of a design solution, glazing in a critical location is installed behind permanent screen protection, the screen should:

- a. prevent a sphere of 75mm from coming into contact with the glazing,
- b. be robust and,
- c. if it is intended to protect glazing that forms part of protection from falling, be difficult to climb.

1.8 Glazing in a critical location which is afforded permanent screen protection, does not, itself, need to comply with requirement N1. The principles of screen protection are shown in Diagram 4.

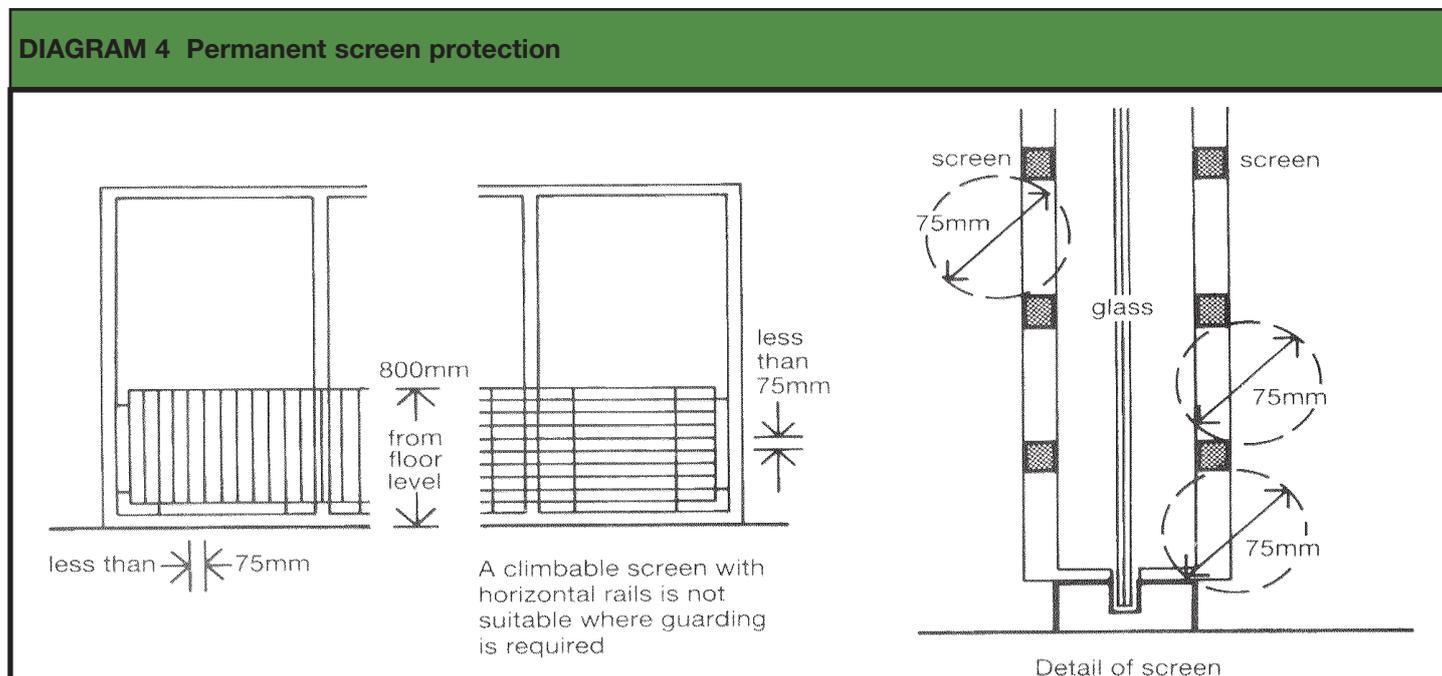

Section 2

Section 2 Manifestation Of Glazing

Critical locations

2.1 Manifestation of glazing is only necessary in critical locations in which people moving in or about the building might not be aware of the presence of the glazing and may collide with it. 'Critical Locations' include large uninterrupted areas of transparent glazing which form, or are part of, the internal or external walls and doors of shops, showrooms, offices, factories, public or other non-domestic buildings.

2.2 The risk of collision is most severe when two parts of the building, or the building and its immediate surroundings, are essentially at the same level but separated by transparent glazing and a person might reasonably have the impression that they are able to walk from one part to the other without interruption.

Permanent manifestation of glazing

2.3 Permanent manifestation of large uninterrupted areas of transparent glazing is only necessary when other means of indicating the presence of the glazing are not used. These other means may include mullions, transoms, door framing or large pull or push handles.



2.4 Where 'manifestation' is necessary, it may take the form of broken or solid lines, patterns or company logos at appropriate heights and intervals (see Diagram 5).

2.5 Diagram 6 includes examples of a number of methods of indicating the presence of glazing.

Alternative indications of glazing

2.6 Examples of installations of glazing which would not normally warrant 'manifestation' include:

- a. door height transparent glazing less than 400mm in width;
- b. door height transparent glazing with a rail at a height of between 600mm and 1500mm above finished ground or floor level;
- c. a single pane glazed door with substantial framing; or,
- d. a single pane glazed door which is either not framed, or which has very narrow framing, but is provided with large easily seen push or pull plates or handles.

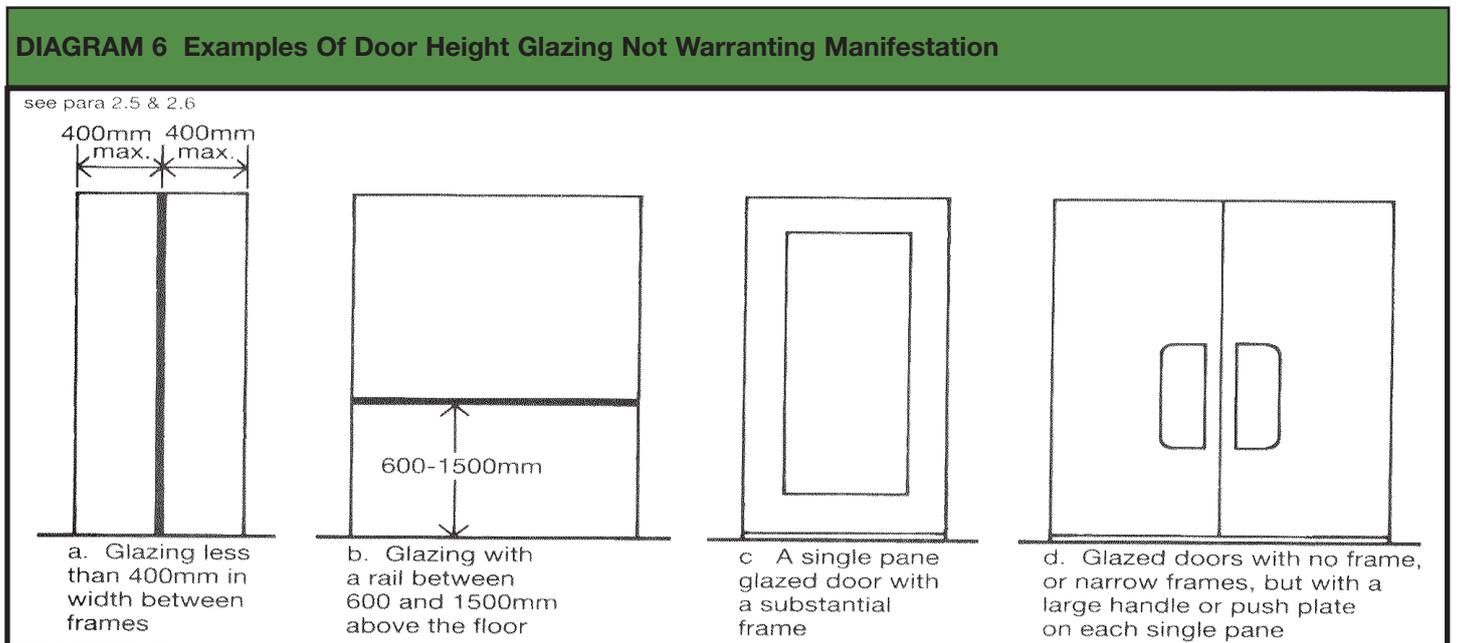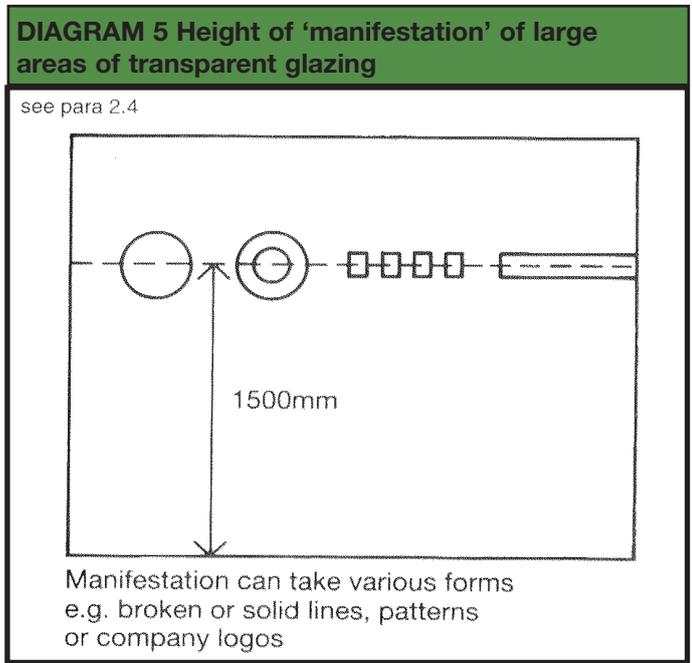

The Requirements N3

Safe Opening And Closing Of Windows Etc The Requirement N3

This Approved Document, which takes effect on 1 January 1998, deals with the following requirement from part N of Schedule 1 to the Building Regulations 1991 as amended by the Building Regulations (Amendment) Regulations 1997.

Requirement	Limits on application
Safe opening and closing of windows etc N3. Windows, skylights and ventilators which apply to can be opened by people in or about the building shall be so constructed or equipped that they may be opened, closed or adjusted safely.	Requirement N3 does not dwellings.

Note

Attention is drawn to the Workplace (Health, Safety and Welfare) Regulations 1992

Compliance with Building Regulation requirement N3 would, in accordance with Section 23(3) of the Health and Safety at Work, etc Act 1974, prevent the service of an improvement notice with regard to the requirements for opening, closing or adjusting windows, skylights and ventilators in regulation 15(1) of the Workplace (Health, Safety and Welfare) Regulations 1992.

GUIDANCE

Performance

Requirement N3

In the Secretary of State's view, requirement N3 will be met if windows, skylights and ventilators which open, can be operated safely.

Section 3

Section 3 Safe Opening And Closing Of Windows Etc

Introduction to provisions

3.1 This Approved Document sets out some ways of complying with the requirement.

Location of controls

3.2

a. Where controls can be reached without leaning over an obstruction they should not be more than 1.9 m above the floor or other permanent stable surface provided to give access. Small recesses, such as window reveals, should be ignored.

b. Where there is an obstruction the control should be lower, eg not more than 1.7 m where there is a 600 mm deep obstruction (including any recess) not more than 900 mm high. See Diagram 7.


c. Where controls cannot be positioned within safe reach from a permanent stable surface, a safe means of remote operation, such as a manual or electrical system should be provided.

Prevention of falls

3.3. Where there is a danger of the operator or other person falling through a window above ground floor level, suitable opening limiters should be fitted or guarding should be provided (see Approved Document K, Protection from falling, collision and impact).

DIAGRAM 7 Height of controls

see para 3.2

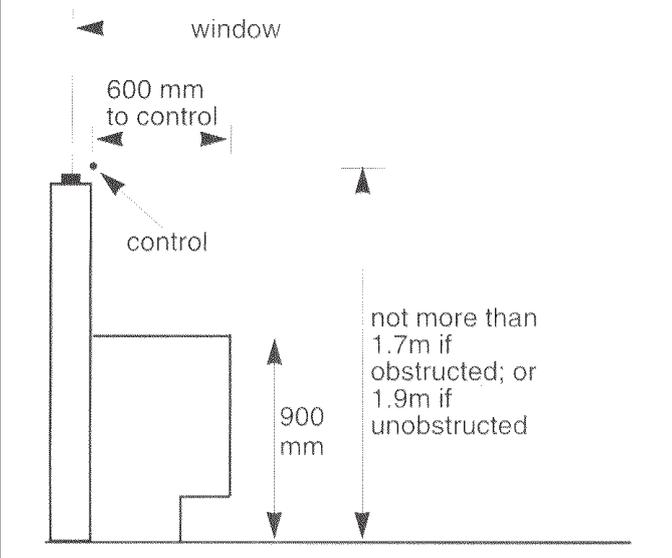

The Requirements N4

Safe Access For Cleaning Windows Etc The Requirement N4

This Approved Document, which takes effect on 1 January 1998, deals with the following requirement from part N of Schedule 1 to the Building Regulations 1991 as amended by the Building Regulations (Amendment) Regulations 1997.

Requirement	Limits on application
Safe access for cleaning windows etc N4. Provision shall be made for any windows, skylights, or any transparent or translucent walls, ceilings or roofs to be safely accessible for cleaning.	Requirement N4 does not apply to: (a) dwellings, or (b) any transparent or translucent elements whose surfaces are not intended to be cleaned.

Note

Attention is drawn to the Workplace (Health, Safety and Welfare) Regulations 1992

Compliance with Building Regulation requirement N4 would, in accordance with Section 23(3) of the Health and Safety at Work, etc Act 1974, prevent the service of an improvement notice with regard to the requirements for cleaning windows and skylights etc in regulation 16 of the Workplace (Health, Safety and Welfare) Regulations 1992.

GUIDANCE

Performance

Requirement N4

In the Secretary of State's view, requirement N4 will be met if provision is made for safe means of access for cleaning both sides of glazed surfaces where there is danger of falling more than two metres.

Section 4

Section 4 Safe Access For Cleaning Windows Etc

Introduction to-provisions

4.1 This Approved Document sets out some ways of complying with the requirement.

4.2 Where glazed surfaces cannot be cleaned safely by a person standing on the ground, a floor, or other permanent stable surface, the requirement could be satisfied by provisions such as the following:

a. provision of windows of a size and design that allow the outside surface to be cleaned safely from inside the building (see Diagram 8). Windows which reverse for cleaning should be fitted with a mechanism which holds the window in the reversed position. Additional guidance is given in BS 8213: Part 1 Windows, doors and roof lights (Approved Document K contains guidance on minimum sill heights.)

b. provision of an adequate area of firm level surface, in a safe place, to allow use of portable ladders not more than 9 m long (measured from the ground to the upper support). Where ladders up to 6 m long will be used, normal soil will provide a suitable standing surface (see Diagram 9); Where ladders over 6 m long will be used suitable tying or fixing points should be provided (see Diagram 10).

c. provision of walkways at least 400 mm wide, either with guarding at least 1100 mm high, or with anchorages for sliding safety harnesses (see Diagram 10);




d. provision of access equipment such as suspended cradles or travelling ladders, with attachments for safety harnesses;

e. provision of suitable anchorage points for safety harnesses or abseiling hooks;

f. only in circumstances where other means cannot be used, space for scaffold towers should be provided, and located so that glazed surfaces can be cleaned.

DIAGRAM 8 Safe reaches for cleaning (see para 4.2)

All dimensions are in mm.

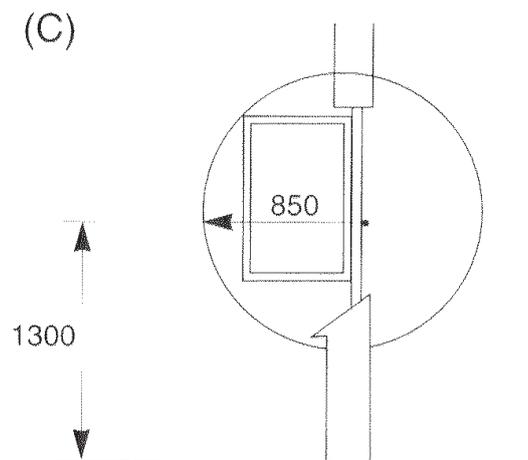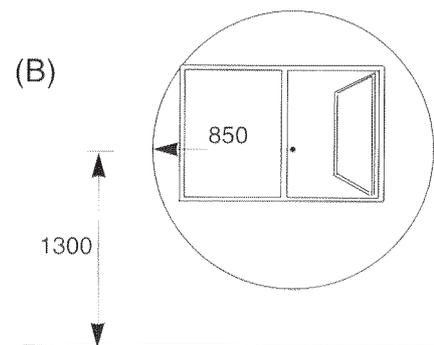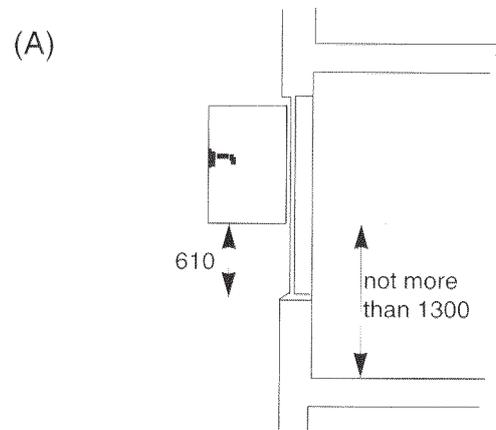


Typical safe reaches for cleaning windows.

- (A) downwards reach through an opening light;
- (B) side reach through an opening light;
- (C) reach for cleaning an open casement with reflex hinges.

DIAGRAM 9 Ladders not more than 6m long


see para 4.2

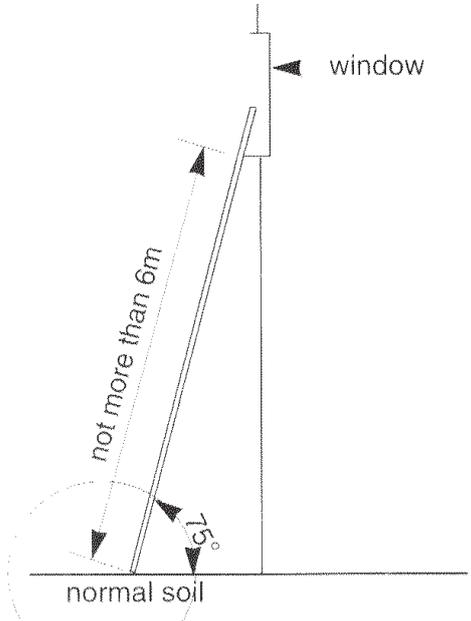

Special safety features are not necessary if the ladder is not more than 6m long.

DIAGRAM 10 Ladders not more than 9m long

see para 4.2

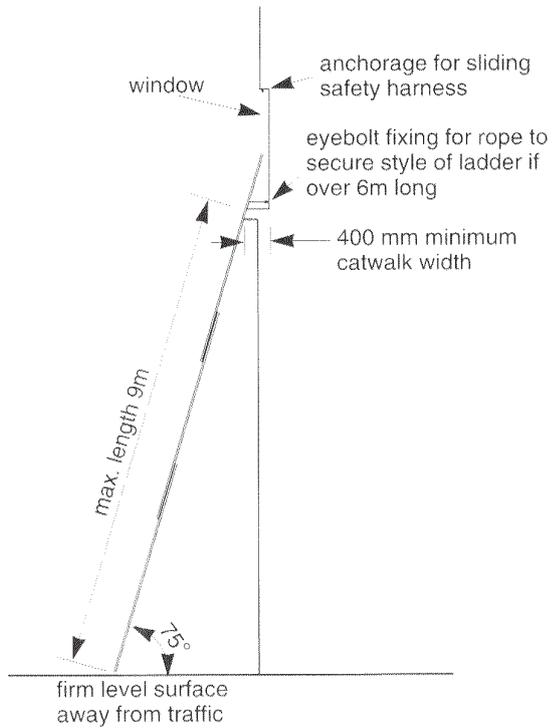

Access to window from a catwalk. Diagram shows:
 - fixing for ladder (see 4.2b) required if it is over 6m long
 - anchorage for sliding safety harness (see 4.2c) for working on a catwalk.

Standards referred to

Standards Referred To

BS 6206: 1 981 Specification for impact performance requirements for flat safety glass and safety plastics for use in buildings.

BS 8213: Part 1: 1991 Windows, doors and rooflights. Part 1. Code of practice for safety in use and during cleaning of windows and doors (including guidance on cleaning materials and methods).